

Webinar

IEA PVPS Task 16: Firm PV Power

Long duration storage modeling in California and Western North America

Prof. Patricia Hidalgo-Gonzalez
phidalgogonzalez@eng.ucsd.edu
<http://ream.ucsd.edu>

Tuesday, August 16th, 2022

UC San Diego
JACOBS SCHOOL OF ENGINEERING

Agenda

The role of long duration energy (LDES) storage in California and Western North America

Methodology: SWITCH WECC model

Wind or solar dominant grids


Varying LDES energy capacity costs

Electricity pricing benefits of LDES

Questions

Methodology: SWITCH WECC model¹

- Capacity expansion deterministic linear program
- Minimizes total cost of the power system:
 - Generation investment and operation
 - Transmission investment and operation
- Geographic:
 - Western Electricity Coordinating Council
 - 50 load areas
- Temporal:
 - Investment periods: 2026-2035 (“2030”); 2036-2045 (“2040”); 2046-2055 (“2050”);
 - Time resolution: sampling every 4 hours, for a subset of days or every day in a year
 - Dispatch simulated simultaneously with investment decisions

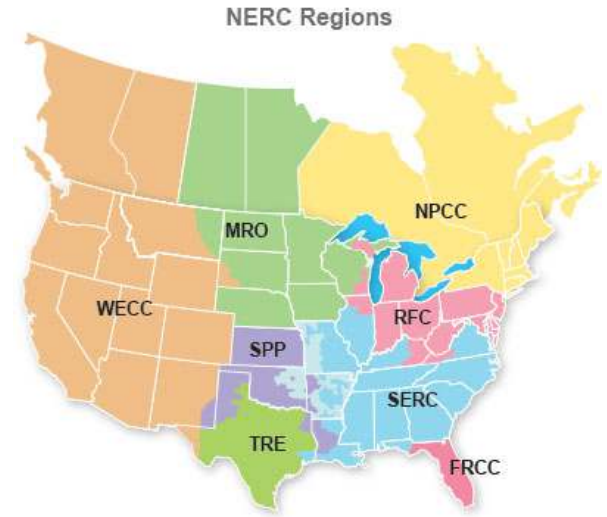


¹ <https://github.com/REAM-lab/switch/>


SWITCH WECC model input data and outputs

INPUTS

- Existing generators in the WECC (3,000+, 2020 EIA Form 860)
- 7,000+ potential new generators
- Aggregated existing transmission capacity
- Hourly loads by zone
- Hourly capacity factors for wind and solar supply
- Fuel and overnight yearly costs projections (NREL ATB 2020)

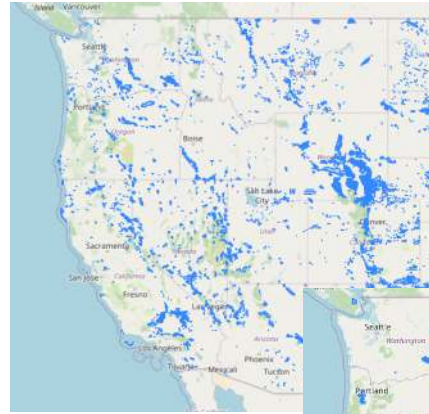

Wind candidates

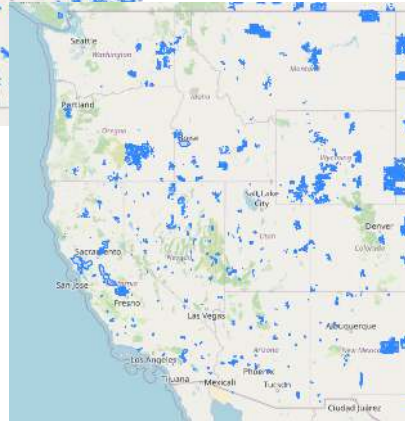

Solar candidates

OUTPUTS

- Optimal investment of new generators by decade until 2050
- Optimal hourly dispatch for each generator
- Optimal transmission capacity expansion by decade until 2050
- Hourly CO2 emissions by generator
- Investment and operational costs

Preliminary results

M. Staadecker, P. A. Sánchez-Pérez , J. Szinai, S. Kurtz, and P. Hidalgo-Gonzalez, “The value of long-duration energy storage and its interaction with a zero-emissions electricity grid” (submitted)

Motivation

- The U.S. future requirement of energy in storage or its duration for a growing demand in a reliable zero emissions grid is still unclear^{1,2}
- Some report 100% renewable energy grids with³ and without storage⁴,
- others rely on “clean firm power”⁵ or even biomass to achieve negative emissions⁶,
- others consider intraday storage⁷, and in some cases seasonal⁸.

¹J. D. Hunt, E. Byers, Y. Wada, S. Parkinson, D. E. H. J. Gernaat, S. Langan, D. P. van Vuuren and K. Riahi, “Global Resource Potential of Seasonal Pumped Hydropower Storage for Energy and Water Storage” *Nature Communications*, 2020,11, 947.

²O. J. Guerra, J. Zhang, J. Eichman, P. Denholm, J. Kurtz and B.-M. Hodge, “The Value of Seasonal Energy Storage Technologies for the Integration of Wind and Solar Power” *Energy & Environmental Science*, 2020,13,1909–1922.

³C. Clack et al., “Evaluation of 100% wind, water, and solar power” *Proceedings of the National Academy of Sciences* Jun 2017, 114 (26) 6722–6727; DOI: 10.1073/pnas.1610381114

⁴Mark Z. Jacobson, Mark A. Delucchi, Mary A. Cameron, Bethany A. Frew “Stabilizing grid with 100% renewables 2050” *Proceedings of the National Academy of Sciences* Dec 2015, 112 (49) 15060–15065; DOI: 10.1073/pnas.1510028112

⁵Nestor A. Sepulveda, Jesse D. Jenkins, Fernando J. de Sisternes, Richard K. Lester, “The Role of Firm Low-Carbon Electricity Resources in Deep Decarbonization of Power Generation” *Joule*, Volume 2, Issue 11, 2018, Pages 2403–2420, ISSN 2542-4351

⁶Sanchez, D., Nelson, J., Johnston, J. et al. Biomass enables the transition to a carbon-negative power system across western North America. *Nature Clim Change* 5, 230–234 (2015).

⁷Fernando J. de Sisternes, Jesse D. Jenkins, Audun Botterud, The value of energy storage in decarbonizing the electricity sector, *Applied Energy*, Volume 175, 2016, Pages 368–379, ISSN 0306-2619

⁸O. J. Guerra, J. Zhang, J. Eichman, P. Denholm, J. Kurtz, B. Hodge, “The value of seasonal energy storage technologies for the integration of wind and solar power” *Energy & Environmental Science*, 2020, Pages 1909–1922

Staadecker, M. et al. “The Value of Long-Duration Energy Storage and Its Interaction with the Western North America Electricity Grid” (in prep.)

Contributions

- Quantification of the benefits in electricity pricing of federal/state mandates for LDES deployment.
- How does the deployment of LDES change depending on:
 1. the ratio of solar/wind deployed
 2. if transmission expansion is restricted?
 3. The costs of long-duration storage (NREL ATB 2020, DOE storage shot, and ultra low)
 4. Hydropower availability

Staadecker, M. et al. “The Value of Long-Duration Energy Storage and Its Interaction with the Western North America Electricity Grid” (in prep.)

Contributions

- Quantification of the benefits in electricity pricing of federal/state mandates for LDES deployment.
- How does the deployment of LDES change depending on:
 - 1. the ratio of solar/wind deployed**
 2. if transmission expansion is restricted?
 - 3. The costs of long-duration storage (NREL ATB 2020, DOE storage shot, and ultra low)**
 4. Hydropower availability

Staadecker, M. et al. “The Value of Long-Duration Energy Storage and Its Interaction with the Western North America Electricity Grid” (in prep.)

Contributions


- Quantification of the benefits in electricity pricing of federal/state mandates for LDES deployment.
- How does the deployment of LDES change depending on:
 - 1. the ratio of solar/wind deployed**
 2. if transmission expansion is restricted?
 - 3. The costs of long-duration storage (NREL ATB 2020, DOE storage shot, and ultra low)**
 4. Hydropower availability

Problem formulation

- 6 hours sampled/day x 365 days/year in 2050
- Zero emissions WECC-wide in 2050

Results: Wind or solar dominant grids

- Nearly all **solar-dominant** load zones have a light pink dot representing **6-to-10-hour storage**
- Nearly all **wind-dominant** load zones have a dark pink dot representing **10-to-20-hour**

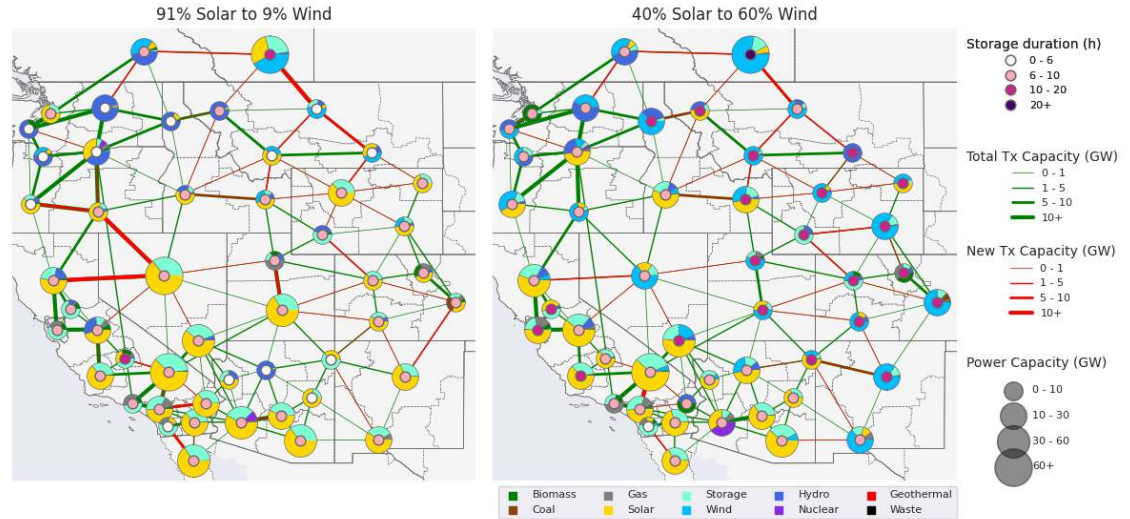

Results: Varying LDES energy capacity costs by 2050

- Energy capacity ranges from 1.5 TWh to 36 TWh
- Largest duration ranges from 9h to 825h
- Transmission deployment decreases by 75% for the cheapest LDES case


Table 2: Storage, wind, and transmission characteristics under varying energy storage costs

Energy Storage Cost	WECC-wide energy storage capacity (TWh)	WECC mean storage duration (h)	Largest storage duration (h)	Wind Capacity (GW)	New Transmission Capacity (million MW-km)
102 \$/kWh	1.5 (-22%)	7.0	8.9	113 (+14%)	27 (+31%)
22 \$/kWh (Baseline)	1.9	8.2	18	99	21
10 \$/kWh	2.4 (+21%)	9.9	29	98 (-1%)	17 (-18%)
5 \$/kWh	6.6 (+239%)	28	378 (16 days)	94 (-5%)	13 (-40%)
1 \$/kWh	22 (+1042%)	96 (4 days)	620 (26 days)	82 (-17%)	4.9 (-76%)
0.5 \$/kWh	36 (+1747%)	151 (6.3 days)	825 (34 days)	69 (-30%)	5.3 (-75%)

Percentages in parentheses represent the change compared to the baseline.



Results: LDES energy capacity mandates

- A: LMPs variability drastically reduced beyond 20 TWh of energy storage

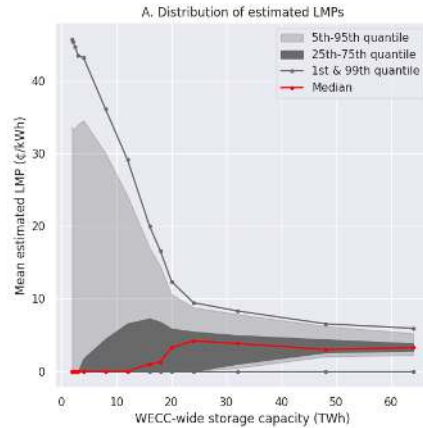




Results: LDES energy capacity mandates

- A: LMPs variability drastically reduced beyond 20 TWh of energy storage
- B: LMP variability across states

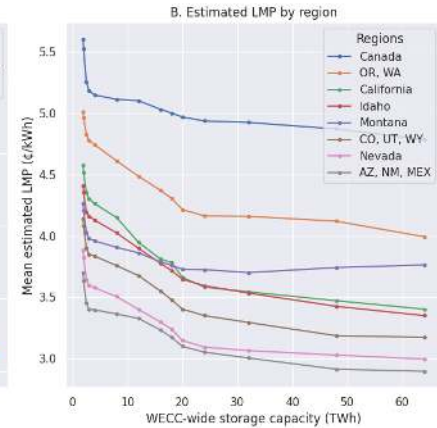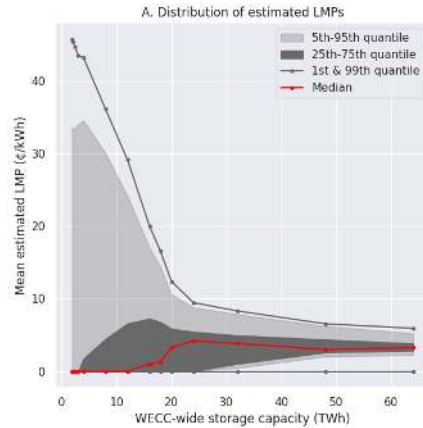





Results: LDES energy capacity mandates

- A: LMPs variability drastically reduced beyond 20 TWh of energy storage
- B: LMP variability across states
- C: 8am – 4pm lowest LMPs due to solar generation
- C: 20 TWh reduce LMPs the most
- C: sharpest drop between 1.94 TWh and 3 TWh: every additional 100 GWh of energy storage decrease night-time LMPs by 1.04%

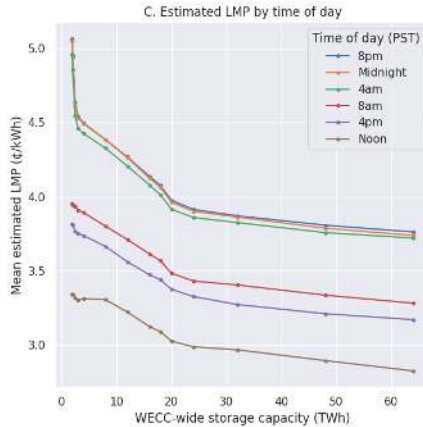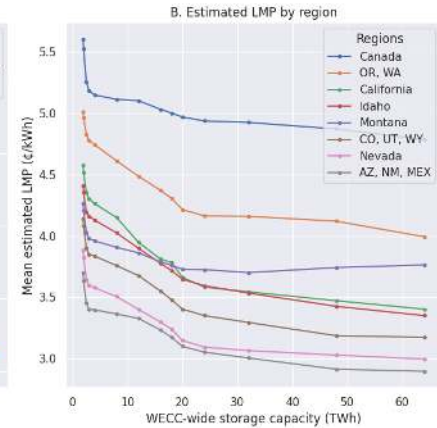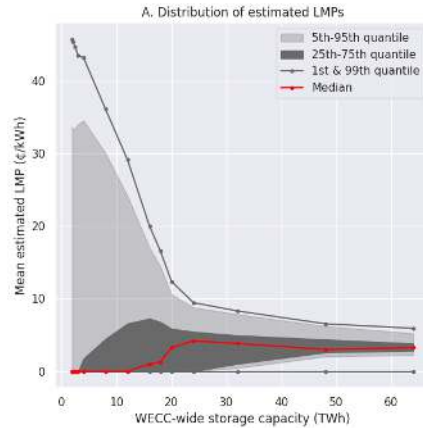

Results: LDES energy capacity mandates

- A: LMPs variability drastically reduced beyond 20 TWh of energy storage
- B: LMP variability across states
- C: 8am – 4pm lowest LMPs due to solar generation
- C: 20 TWh reduce LMPs the most
- C: sharpest drop between 1.94 TWh and 3 TWh: every additional 100 GWh of energy storage decrease night-time LMPs by 1.04%
- D: LMPs are highest in July and December (highest demands) while near zero in other months due to excess renewable energy

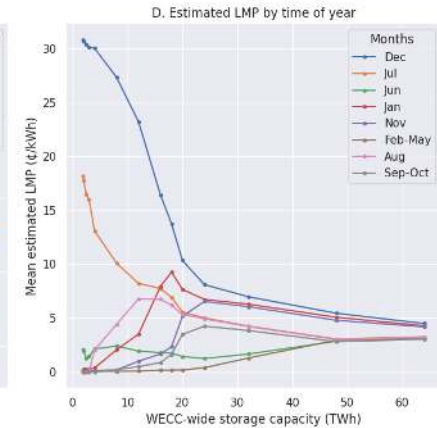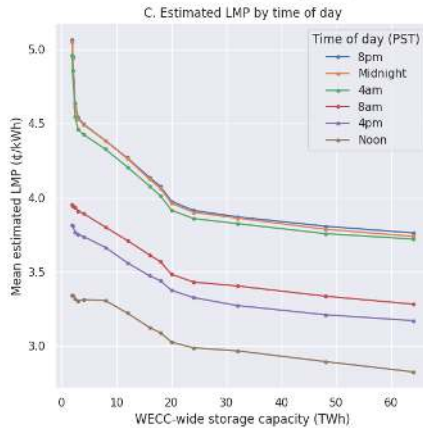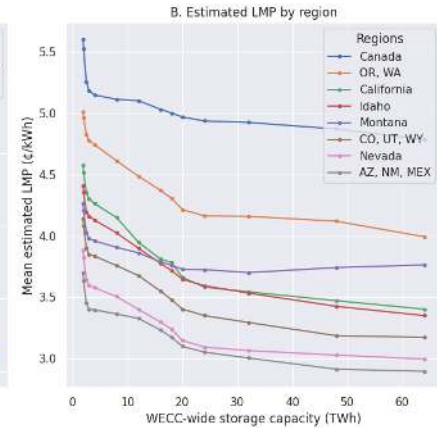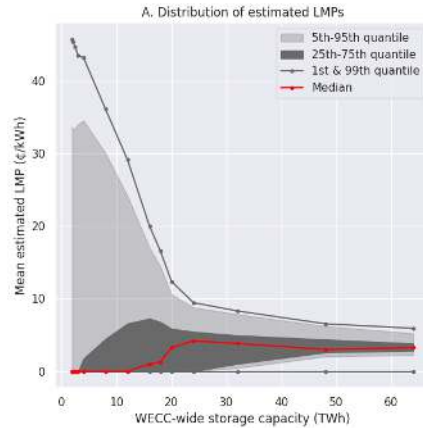

Conclusions

- Depending on the grid composition, solar or wind dominant, 6-to-10 hours or 10-to-20 hours LDES duration will optimally support its operation
- R&D can play a key role in the optimal deployment of LDES. Achieving an energy capacity capital costs of \$5/kWh can enable 28 hours of mean duration, and a maximum of ~400 hours
- Storage mandates can mitigate electricity prices variability and seasonality in a zero emissions grid

Questions?

Prof. Patricia Hidalgo-Gonzalez

phidalgogonzalez@eng.ucsd.edu

<http://ream.ucsd.edu>

Wednesday, June 1st, 2022

UC San Diego

JACOBS SCHOOL OF ENGINEERING

Architecture of the SWITCH WECC model¹

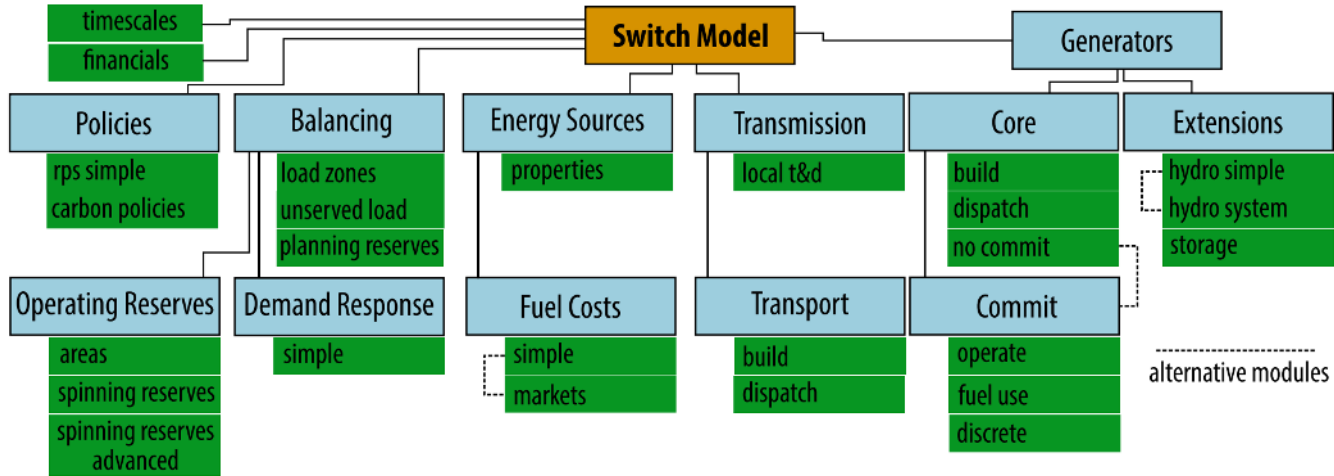


Image source: J. Johnson et al., Switch 2.0: A modern platform for planning high-renewable power systems, 2019

¹ <https://github.com/REAM-lab/switch/>